

601 N. Moapa Valley Boulevard * Post Office Box 257 * Logandale, Nevada * 89021
Telephone (702) 397-6893 * Facsimile (702) 397-6894

PERMIT FOR CONSTRUCTION WATER A copy of this permit MUST be in EACH vehicle used when connected to the District system and must be made immediately available for inspection upon request.

Permittee: _____ Date: _____

Mailing Address: _____ Phone: _____

Billing Preference: Paperless/Email Paper/mailed Both Email Address: _____

Project Description: _____

Location: _____

Duration of the Project: _____ Days (Maximum of 180 Days)

- The Moapa Valley Water District reserves the right to meter any and all permits for hydrant usage.
 - In the case of loss, destruction, or abuse (beyond reasonable wear and tear) to the hydrant or meter assembly, the permitted party will become liable for the repair or replacement costs of said hydrant or meter assembly.
 - ANY unauthorized usage of hydrants constitutes diversion or theft of water with the intent to avoid payment, per NRS 704.800, and may constitute a Class D Felony.
 - Any customer diverting or stealing water from the District shall be subject to a minimum charge of \$1000 to cover administrative costs associated with the investigation and possible prosecution of theft.
- _____ Permitted Signature

- An approved backflow prevention assembly shall be installed on the outlet where the water is or may be used to supply the consumer in a manner which would create a potential hazard to the public water system.
 - On-site inspection of the connection to the hydrant and any equipment to be used IS REQUIRED prior to final authorization of the permit. A permanent fixed air gap or a reduced pressure principal backflow assembly will be required.
 - Once the connection has been established, the permit holder may not change the equipment or connection or operate the hydrant.
 - Permit holders who violate conditions of this permit will be liable for public health effects caused by backflow conditions created by their connection and also assume liability for damages to District or customer facilities.
- _____ Permitted Signature

The following charges apply:
Please initial

- _____ \$1,000.00 Hydrant meter deposit; Refundable after verification that both the hydrant and the meter are undamaged, operational and the final bill has been paid.
- _____ Non-refundable application fee
- _____ Usage fee \$1.12 per day
- _____ Water \$3.40 per 1,000 gallons
- _____ You must provide a valid dust permit.

I hereby request a fire hydrant use permit and agree to pay all charges accrued against this permit. I understand that invoices for hydrant use are due upon receipt, become delinquent 15 days later and ARE subject to a 10% late fee. If at any time, an invoice becomes 30 days late this hydrant permit will be revoked, and the hydrant meter will be pulled. Once revoked a permit may not be reissued until all charges are paid in full, a new permit application is completed, and a new permit fee paid. Reconnection will require an on-site inspection.

Permitted Signature _____ Date _____

Hyd Meter #:	_____	Meter Install Date:	_____	Beginning read:	_____
Ending Read:	_____	Hydrant Designated for use:	_____		
Approved Connections:	_____				

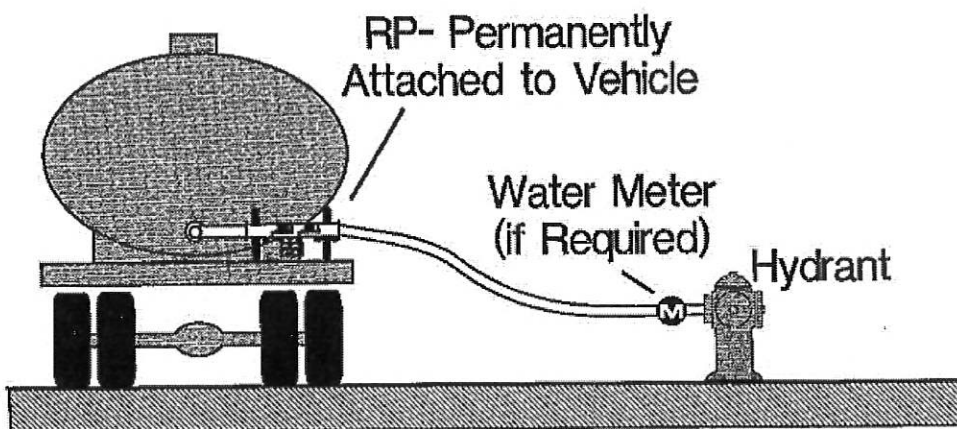
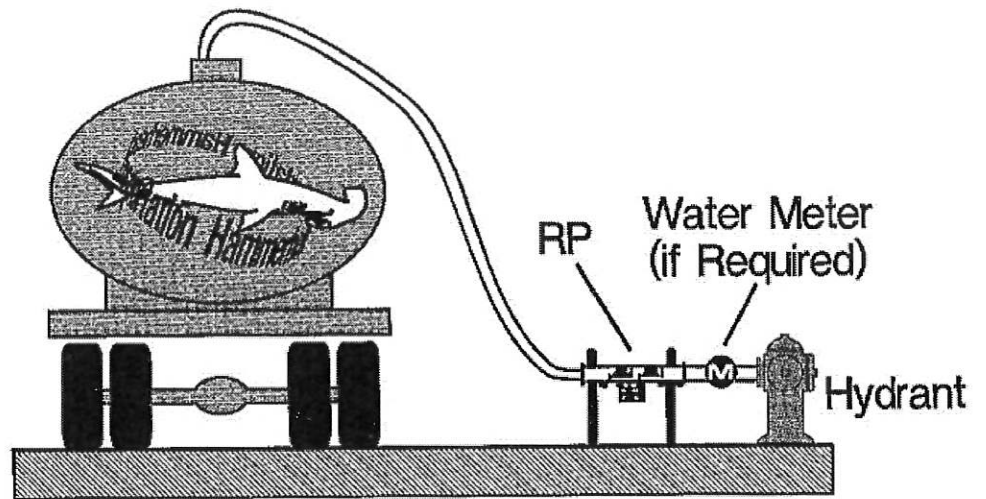
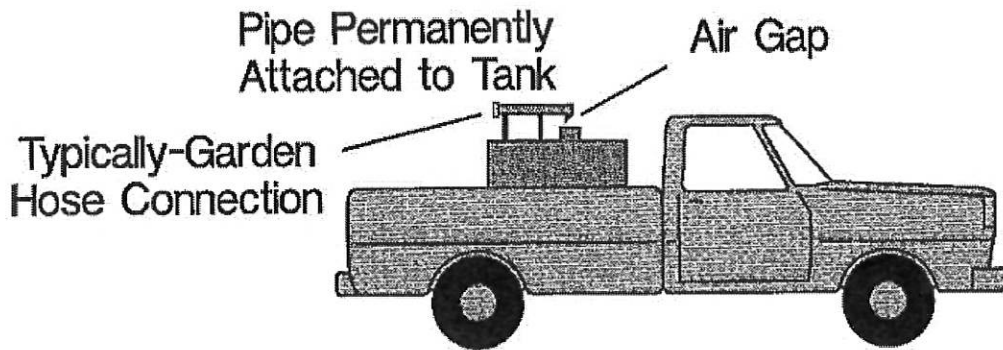
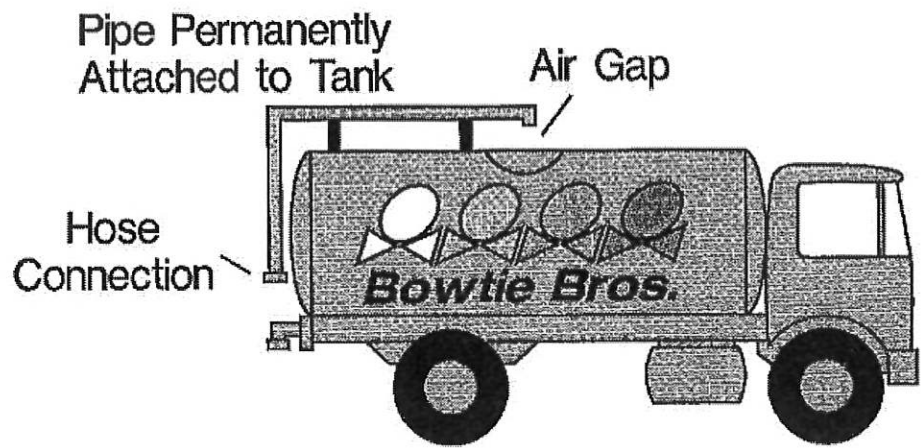


Fig. 7.21

Proper Methods of Filling Portable Spray and Cleaning Equipment